


String 1 // MPPT1.1 -> $UDC_{max-10C} = 37,32V * [1 + (-0,275\%/^{\circ}C * [-10^{\circ}C - 25^{\circ}C])/100\%]$ = 40,81V/Modul /// 489,72V /// 4920kWp
String 2 // MPPT1.2 -> $UDC_{max-10C} = 37,32V * [1 + (-0,275\%/^{\circ}C * [-10^{\circ}C - 25^{\circ}C])/100\%]$ = 40,81V/Modul /// 489,72V /// 4920kWp
String 3 // MPPT2 -> $UDC_{max-10C} = 37,32V * [1 + (-0,275\%/^{\circ}C * [-10^{\circ}C - 25^{\circ}C])/100\%]$ = 40,81V/Modul /// 326,48V /// 3280kWp

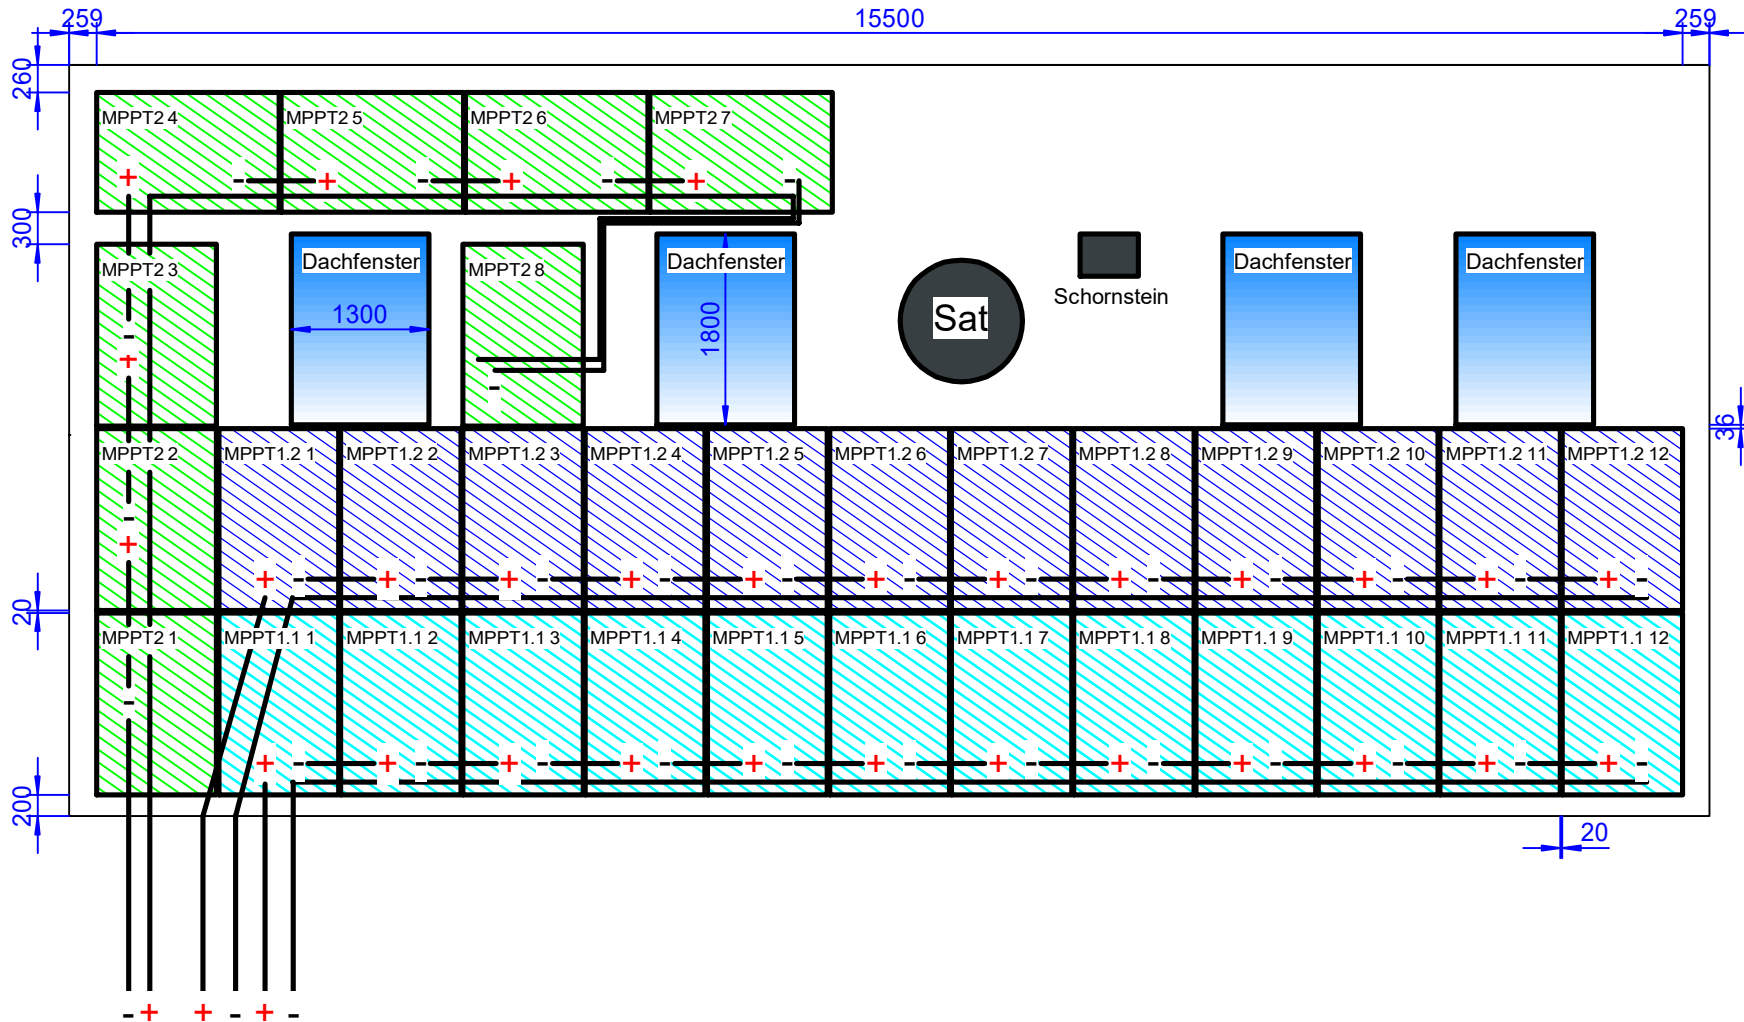

Zustand		Änderung	Datum	Name	Datum	Name	Siemens Aktiengesellschaft LDA EA DE EC Werner-von-Siemens-Allee 4 / 66115 Saarbrücken		TENADO® CAD 2D		BENENNUNG Modulbelegungsplan		Maßstab 1:50	Gewicht:	Blatt-Nr.: 1 von
Ers. durch:		Ers. für:		Ers. durch:		Zul. Abweichung:		Motortyp:		Fabrik-Nr.:		Werkstoff:		1 Blättern	
1		2		3		4		5		6		7		8	